

FOUNDATION NOTES

1. ALL FILL MATERIAL TO BE COMPACTED TO 95% STANDARD PROCTOR.
2. CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3500 PSI (MIN.) IN 28 DAYS.
3. ALL REINFORCING STEEL SHALL BE GRADE 60 AND SETTING ON APPROVED CHAIRS.
4. ALL REINFORCING STEEL LAPS SHALL BE 24"(MIN.).
5. ALL REINFORCING STEEL SHALL BE 2" FROM OUTSIDE EDGES OF CONCRETE FOOTINGS.
6. ANCHOR BOLTS TO BE $^1/_2$" DIA. @ 3' O.C. EMBEDDED TO 10".

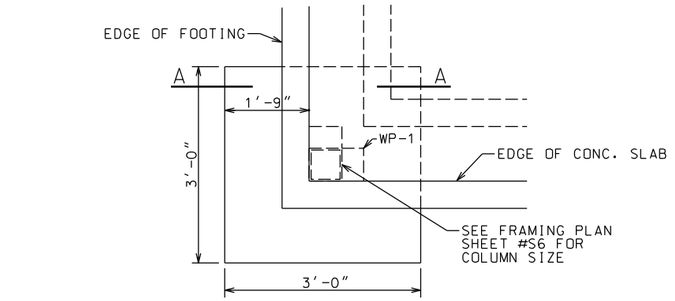


PLAN VIEW

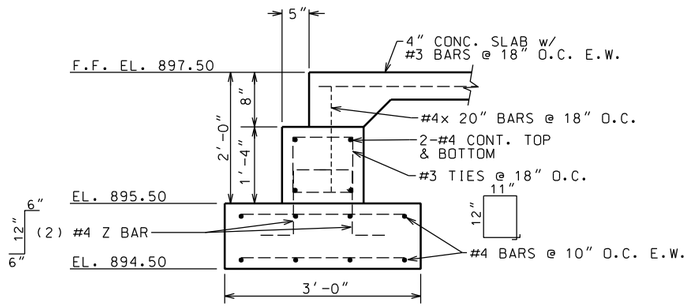



SECTION A-A

DETAIL "A-S2"

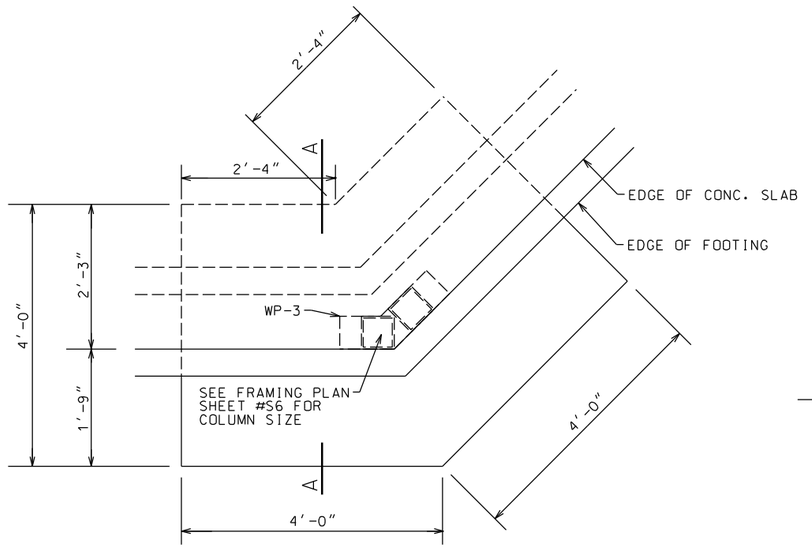


PLAN VIEW

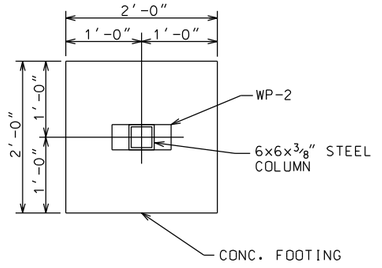


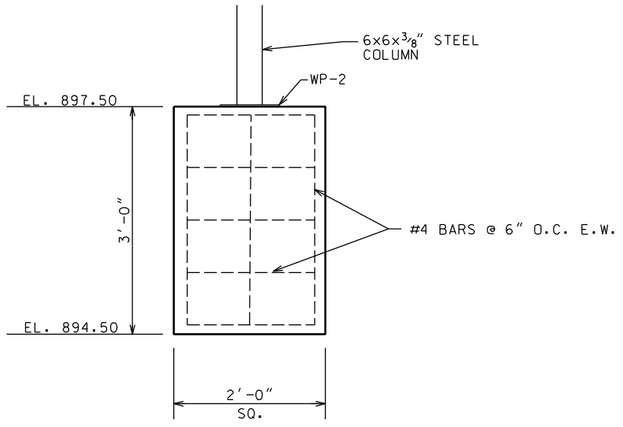

DETAIL "C-S2"

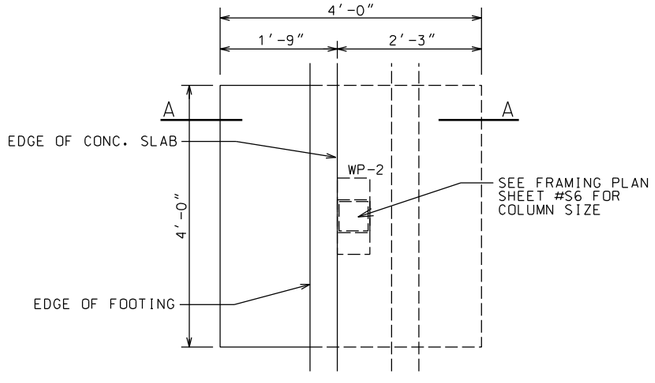


PLAN VIEW

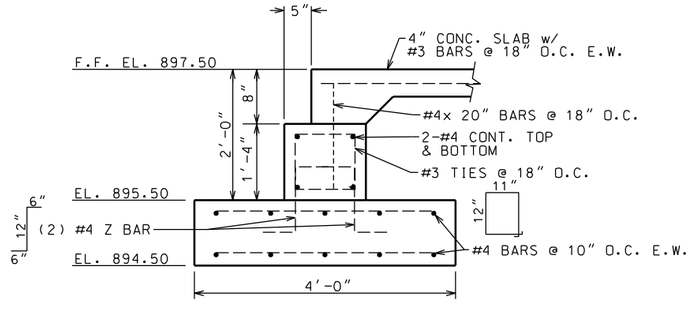


SECTION A-A

DETAIL "B1-S2"

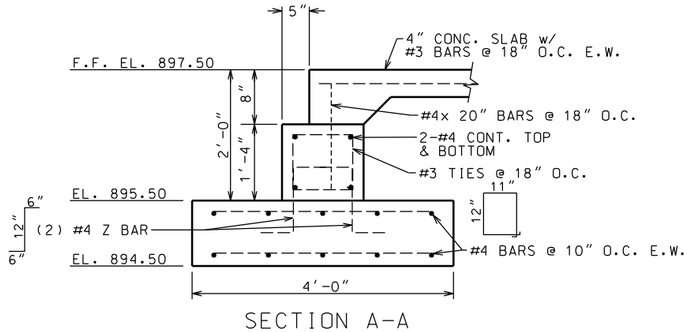

SECTION A-A

DETAIL "B-S2"

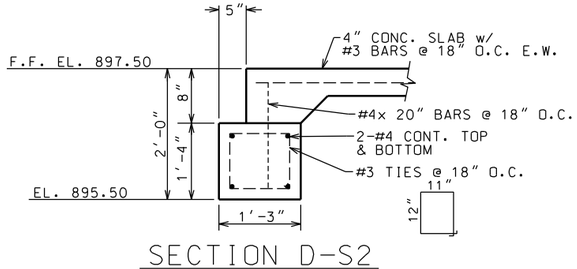

SECTION D-S2

FOOTING DETAILS

NOT TO SCALE

ENGINEERING CONSTRUCTION SERVICES, LLC
402 KINGS ROAD, ARDMORE, OKLAHOMA
TEL. (580) 504-4120

C.A. NO. 4810
EXPIRES 6-30-2019

CONVENIENCE STORE
FOR
H AND H 1313, INC.
ARDMORE, OKLAHOMA

DATE:
1-28-2019

REV. DATE:

SHEET
S2
OF 9